


APPLICATION 1

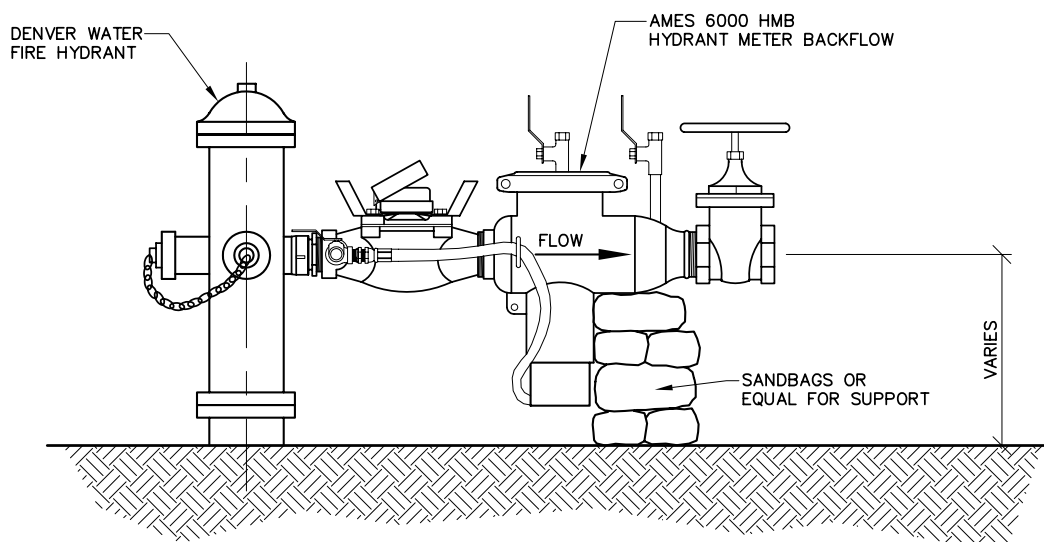

APPLICATION 2

NOTES:

1. METER AND RPZ BACKFLOW DEVICES SHALL BE FULLY SUPPORTED WHEN CONNECTED TO FIRE HYDRANT.
2. METERS AND RPZ BACKFLOW DEVICES SHALL BE APPROVED BY DENVER WATER. (MS-30)
3. METERS SHALL BE TESTED ANNUALLY BY DENVER WATER.
4. BACKFLOW DEVICES SHALL BE ANNUALLY TESTED AND COPY OF TEST SHALL BE SENT TO DENVER WATER, BEFORE USAGE WILL BE ALLOWED.
5. DENVER WATER MUST BE NOTIFIED OF HYDRANT TO BE IN USE.
6. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ANY DAMAGE TO FIRE HYDRANT DURING USE.

DENVER WATER

1600 West 12th Avenue • Denver, Colorado 80204
Phone (303) 628-6000 • Telecopier No. (303) 628-6851

**STANDARD DESIGN FOR
HYDRANT METER INSTALLATION**

Scale: NONE Date: DECEMBER 1999

Drawn: C.B.B. Tr: Ck:

Approved: Dr. 127 No. 35